

C. Westoby 11-30-90
APPROVED/DATE

SAFETY ORGANIZATION(S):

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

- UL 1283
- CSA 22.2, NO. 0, 0, 4, 8
- VDE APPROVED (PENDING)
- VDE 565-3

OPERATING SPECIFICATIONS:

- LINE VOLTAGE/CURRENT, 3 AMP., 120/250 VAC
- LINE FREQUENCY, 3 AMP./40°C, 250 VAC 50-60Hz

MAX. LEAKAGE CURRENT, EACH LINE TO GROUND

- .25 mA @ 120V 60 Hz
- .48 mA @ 250V 50 Hz

OPERATING AMBIENT TEMP. RANGE:

- 10°C TO +40°C @ RATED CURRENT, I_r

IN AN AMBIENT, T_o, HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, I_o, IS AS FOLLOWS:

$$I_o = I_r \sqrt{\frac{85 - T_o}{45}}$$

RELIABILITY SPECIFICATIONS:

- STORAGE TEMPERATURE, -40°C TO +85°C
- HUMIDITY, 21 DAYS @ 40°C 95% RH
- CURRENT OVERLOAD TEST, 6 TIMES RATED CURRENT FOR 8 SECONDS

TEST SPECIFICATIONS:


- INDUCTANCE, 1.75 mH NOMINAL
- CAPACITANCE, (MEASURED @ 1 KHz, 0.25 VAC MAX., 25°C ±1°C) .003μF ±20%
- LINE TO GROUND, 1.08μF ±20%
- LINE TO LINE, 330KΩ
- DISCHARGE RESISTOR 6000 MΩ (MIN) AT 100 VDC
- LINE/GROUND AND LINE/LINE INSULATION RESISTANCE 20°C AND 50% RH

RECOMMENDED RECEIVING INSPECTION HIPOT:

- 2250 VDC FOR 1 MINUTE
- 1450 VDC FOR 1 MINUTE


FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

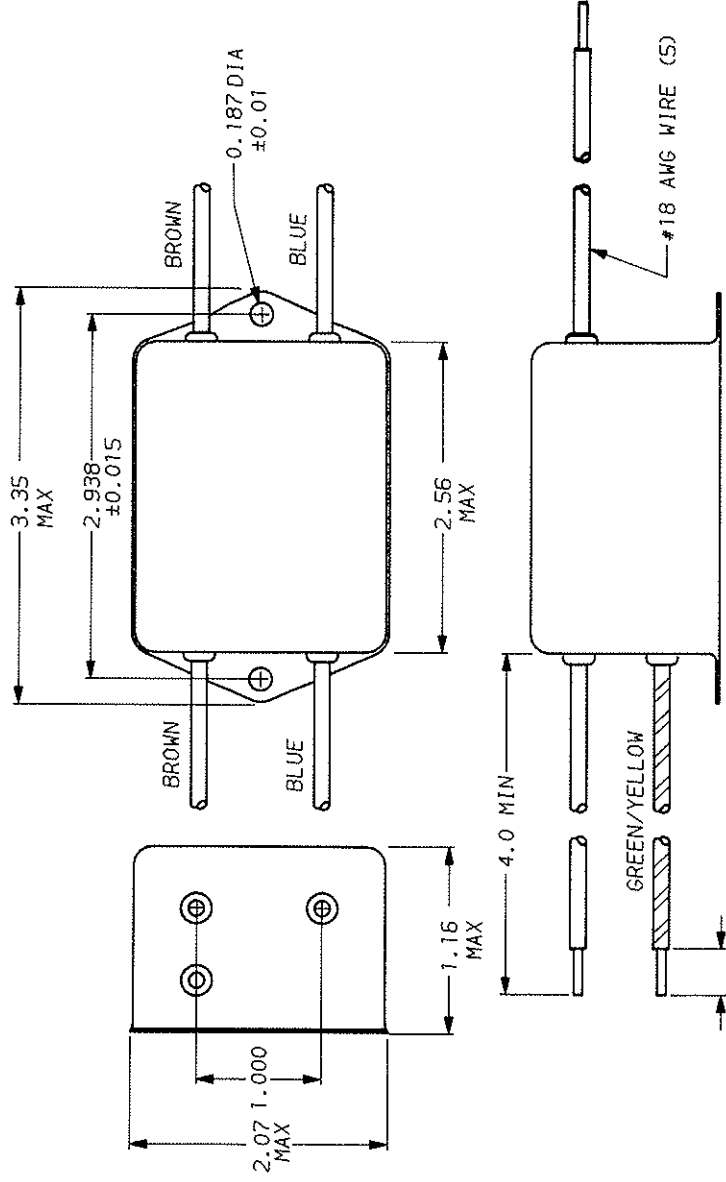

FREQUENCY MHz	50Ω - 50Ω (MINIMUM) INSERTION LOSS						
	.15	1	2	5	10	20	30
COMMON dB	17	31	39	44	47	50	52
DIFF. dB	30	55	65	65	62	62	62

This document is proprietary to CORCOM INC. and is not to be reproduced nor used for manufacturing purposes except on CORCOM's order or prior written consent.

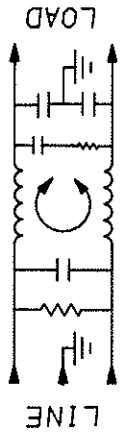

DECIMAL: .XXX .XX .X ANGLES ± 1°
ENGLISH: ±.025
METRIC: ±
MATERIAL: AS SUPPLIED

FINISH: AS SUPPLIED

CORCOM
LIBERTYVILLE, IL 60048

POWER LINE FILTER

SCALE	DATE	DRG. NO.	REV.
NTS	11-5-90		3EDK3.00
REV. BY	ORIGINATOR		
CFW	CFW		